


ELEVATION SECTION

3/4" GRAVEL FOUNDATION OUTSIDE SHAPE MAY BE IRREGULAR. MAXIMUM THICKNESS WILL DEPEND ON SPECIFIC SITE CONDITIONS.

PIPES VARY IN SIZE

RESILIENT CONNECTION BETWEEN PIPES AND MANHOLE REQUIRED

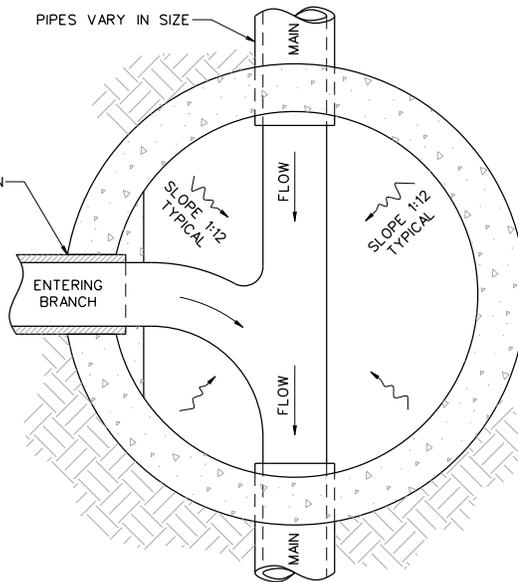

SECTION A-A

NOTES:

1. MANHOLE COVER TO CONTAIN ONE PICK HOLE. SEE SPECIFICATION DIVISION 5 FOR COVER LABEL. D&L SUPPLY P/N A-1180 (OR EQUAL).
2. STEPS SHALL BE MADE OF COPOLYMER POLYPROPYLENE CONFORMING TO ASTM D-4101. REINFORCING STEEL TO BE DEFORMED 1/2" DIAMETER GRADE 60 ROD.
3. FLAT LIDS MAY BE USED IN LIEU OF ECCENTRIC CONES WHERE NECESSARY. FLAT LIDS SHALL BE OF ECCENTRIC DESIGN AND MEET H20 LIVE LOADING. NO FLAT RING AND COVERS WILL BE ALLOWED UNLESS APPROVED BY PUBLIC WORKS.



STATEMENT OF USE

THIS DOCUMENT AND ANY ILLUSTRATIONS HEREON ARE PROVIDED AS STANDARD CONSTRUCTION DETAILS WITHIN LINDON CITY. DEVIATION FROM THIS DOCUMENT REQUIRES APPROVAL OF LINDON CITY, LINDON CITY CORPORATION AND J-U-B ENGINEERS CAN NOT BE HELD LIABLE FOR MISUSE OR CHANGES REGARDING THIS DOCUMENT.

REVISION

NO.	DESCRIPTION	BY	APR.	DATE
1	ADD CONCRETE COLLAR TO MANHOLE RING	CJF	M.C.	1/22/04
2	REPLACED PART NUMBER IN NOTES	TRG	M.C.	1/09/08
3	REVISED MANHOLE BASE SLOPE	BTB	M.C.	12/06/11



TYPICAL MANHOLE DETAIL

LINDON CITY
100 NORTH STATE

STANDARD DRAWING NUMBER:	11
CAD DWG: LC_StdMags.dwg	
PLOT SCALE:	1:000
DRAWN BY:	BK.W
DESIGN BY:	DCT
CHECKED BY:	MJ
ADOPTED DATE:	07 FEB 12