

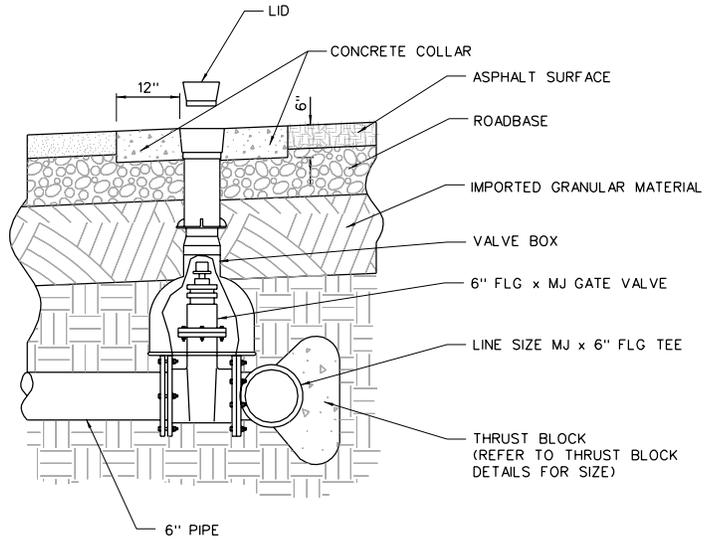



MUELLER "SUPER CENTURION 200"  
OR WATEROUS "PACER"  
5/4" FIRE HYDRANT

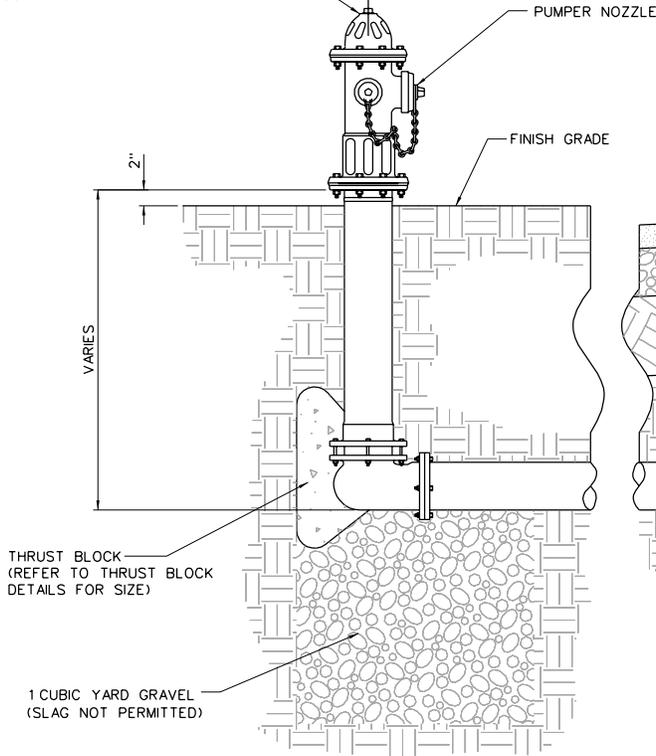

**FIRE HYDRANT & WATER VALVE**

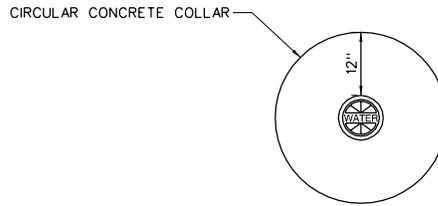


**CULINARY WATER VALVE  
CONCRETE COLLAR**

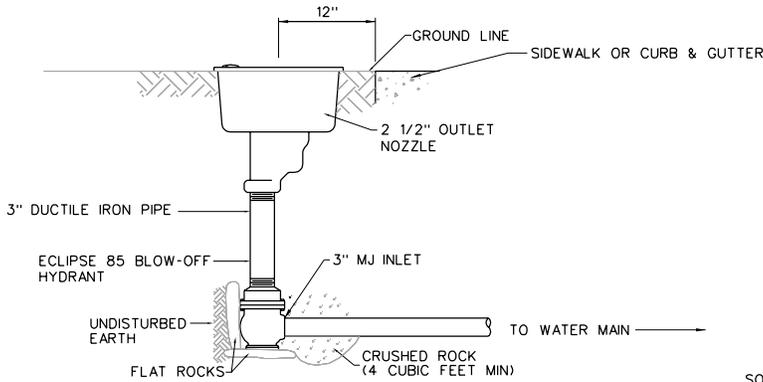

**BLOW-OFF HYDRANT**

NOTE:  
A GATE VALVE WITH VALVE BOX  
(ACCESSIBLE FROM THE SURFACE)  
SHALL BE INSTALLED AT THE WATER  
MAIN CONNECTION.

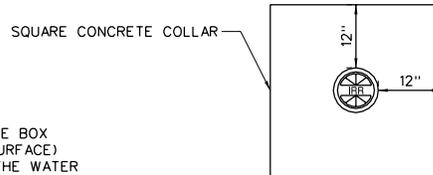

**PRESSURE IRRIGATION VALVE  
CONCRETE COLLAR**



**STATEMENT OF USE**

THIS DOCUMENT AND ANY ILLUSTRATIONS HEREON ARE PROVIDED AS STANDARD CONSTRUCTION DETAILS WITHIN LINDON CITY. DEVIATION FROM THIS DOCUMENT REQUIRES APPROVAL OF LINDON CITY, LINDON CITY CORPORATION AND J-U-B ENGINEERS CAN NOT BE HELD LIABLE FOR MISUSE OR CHANGES REGARDING THIS DOCUMENT.

**REVISION**

NO.	DESCRIPTION	BY	APPR	DATE
1	ADD BLOW OFF HYDRANT AND CONCRETE COLLAR DETAILS	CJF	M.C.	20JAN04
2	ADDED NOTE	TRG	M.C.	9JAN08
3	UPDATED NOTES	SAC	M.C.	22DEC08



**FIRE HYDRANT, BLOW-OFF HYDRANT  
& WATER VALVE DETAIL**

LINDON CITY  
100 NORTH STATE

STANDARD DRAWING NUMBER:	<b>14</b>
CAD DWG: LC StdDwg.dgn	
PLOT SCALE:	1:000
DRAWN BY:	BRW
DESIGN BY:	DCI
CHECKED BY:	MJL
ADOPTED DATE:	(BY DRC) 8 JAN 09