


NOTE:  
 8' LENGTH OF 2 1/2" FIRE HOSE TO BE FURNISHED WITH EACH AIR INLET & REMOVAL FACILITY - FOR CURB & GUTTER INCLUDE A 2 1/2" MALE END ADAPTER & A 2 1/2" FEMALE END ADAPTER WITH AN AKRON SWIVEL ELBOW #232 - 45 DEGREES AT THE FEMALE END. HOSE & FITTING TO BE RATED FOR 120 PSI WORKING PRESSURE.

### STANDARD SECTION WHERE NO STREET IMPROVEMENTS EXIST

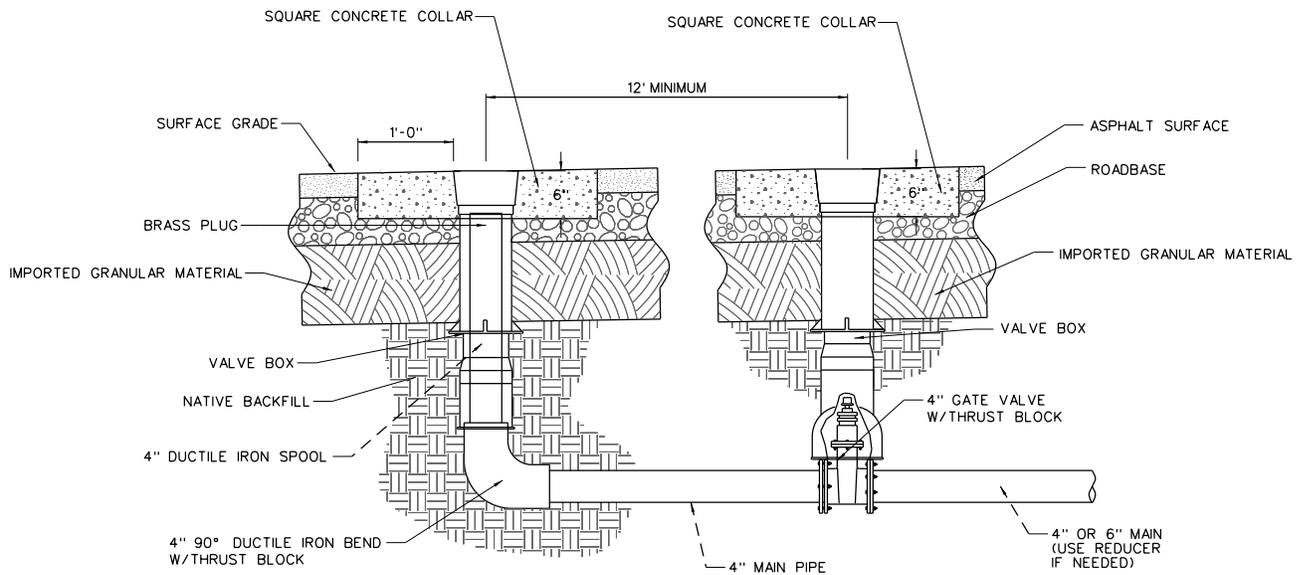

NOTE:  
 PLACE VALVE BETWEEN THE AIR INLET AND REMOVAL FACILITY AND THE LAST SERVICE ON THE LINE, JUST BEYOND THE SERVICE

### STANDARD SECTION WHERE STREET IMPROVEMENTS EXIST



#### STATEMENT OF USE

THIS DOCUMENT AND ANY ILLUSTRATIONS HEREON ARE PROVIDED AS STANDARD CONSTRUCTION DETAILS WITHIN LINDON CITY. DEVIATION FROM THIS DOCUMENT REQUIRES APPROVAL OF LINDON CITY CORPORATION AND J-U-B ENGINEERS CAN NOT BE HELD LIABLE FOR MISUSE OR CHANGES REGARDING THIS DOCUMENT.

#### REVISION

NO.	DESCRIPTION	BY	DATE
1	MODIFY STANDARD SECTION WHERE STREET IMPROVEMENTS EXIST	CJC	M.C. 01/20/2005
2	ADD VALVE BOX TO THE AIR INLET	CJC	M.C. 02/20/07
3	INSERTED BRASS PLUG ANNOTATION	TRG	M.C. 07/20/08
4	REVISED CALLOUTS, ADDED DIMENSION IN LOWER DETAIL	EEL	M.C. 02/07/15



## FLUSHING, AIR INLET & REMOVAL FACILITY FOR PRESSURE IRRIGATION

LINDON CITY  
 100 NORTH STATE

STANDARD DRAWING NUMBER:	21
CAD DWG: LC_StdDwg.dwg	
PLOT SCALE:	1,000
DRAWN BY:	CJC
DESIGN BY:	MLC
CHECKED BY:	MLC
ADOPTED DATE:	07 APR 15