




Pressurized Irrigation System Connection

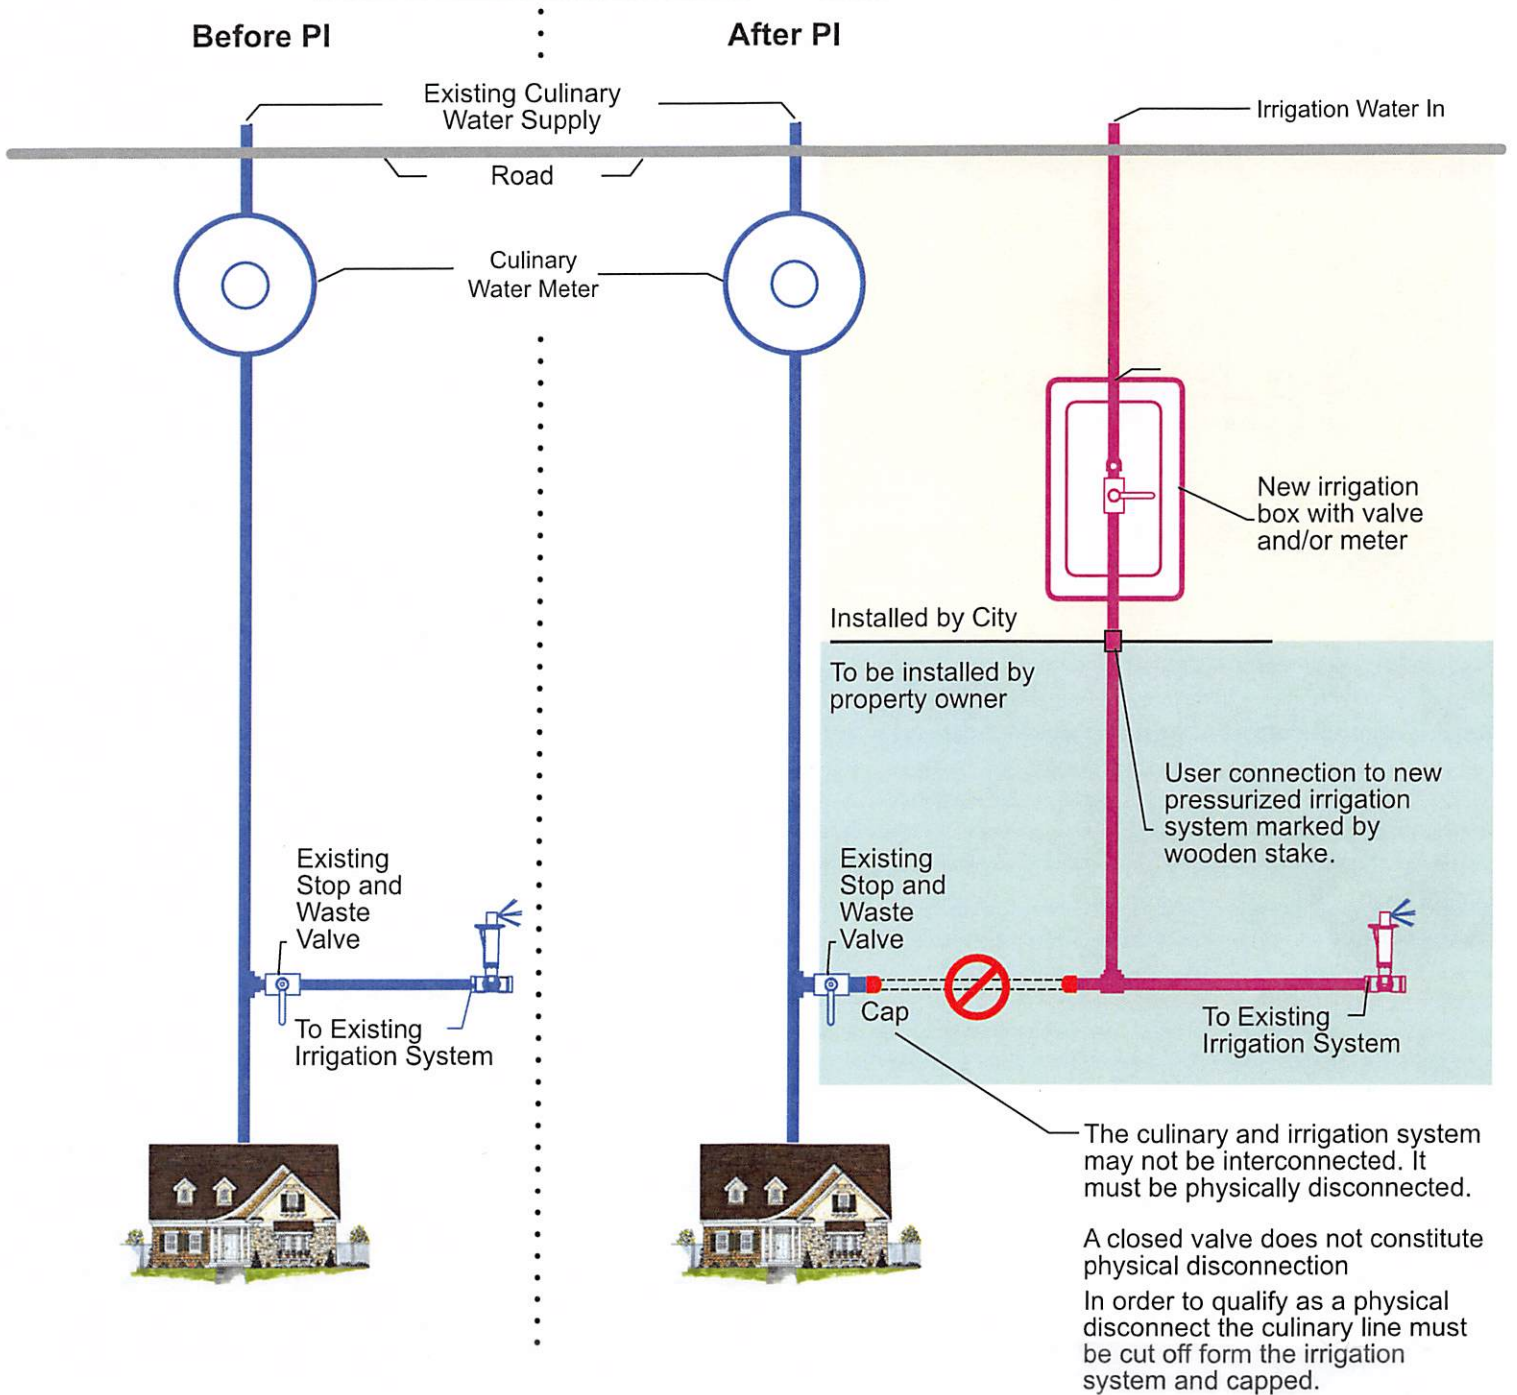

The culinary and irrigation system may not be interconnected. It must be physically disconnected.

A closed valve does not constitute physical disconnection

In order to qualify as a physical disconnect the culinary line must be cut off from the irrigation system and capped.

Cross connection of the culinary water system to the pressurized irrigation system is prohibited as it may result in the contamination of the culinary water service and possible fines.

Please call the City office at 801-423-2770 for an inspection to verify that the connection has been performed properly before burying the connection.