


LOCAL RESIDENTIAL
50' STREET CROSS-SECTION
LOOKING NORTH OR WEST

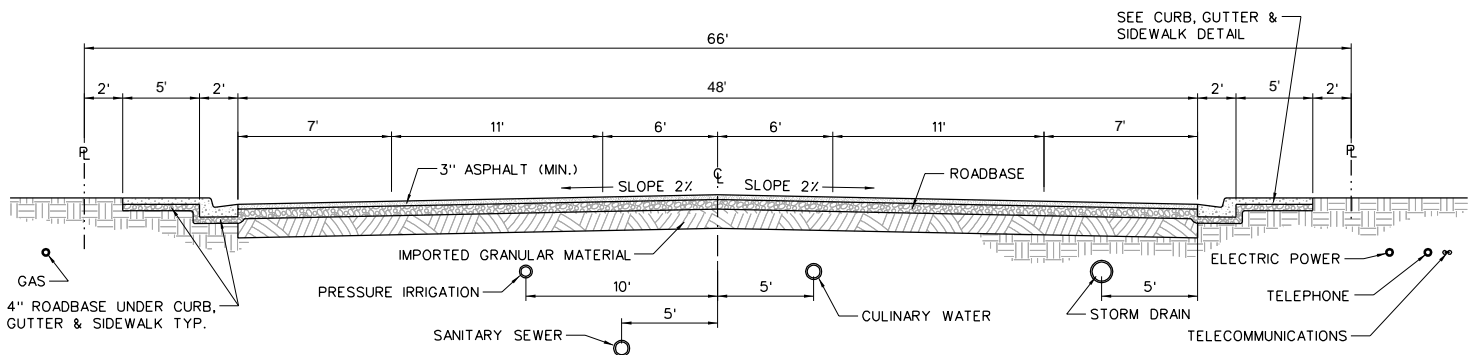

COLLECTOR & LOCAL COMMERCIAL
66' STREET CROSS-SECTION
LOOKING NORTH OR WEST

NOTES:

1. IMPORTED GRANULAR MATERIAL (SUB-BASE), ROADBASE, AND ASPHALT THICKNESSES SHALL BE DETERMINED BY PAVEMENT DESIGN.
2. DRINKING WATER PIPELINES SHALL BE INSTALLED ON THE NORTH AND EAST SIDE OF THE STREET, UNLESS APPROVED OTHERWISE BY THE CITY ENGINEER.
3. FIRE HYDRANTS SHALL BE LOCATED EVERY 400 FEET AND ON THE SAME SIDE OF THE STREET AS THE DRINKING WATER PIPELINES, UNLESS APPROVED OTHERWISE BY THE CITY ENGINEER.
4. WATER VALVES SHALL BE CLUSTERED AT THE FITTING ON THE MAIN, UNLESS APPROVED OTHERWISE BY THE CITY ENGINEER.
5. ALL DRINKING WATER MAIN PIPELINES SHALL BE 8-INCH MINIMUM.
6. ALL PRESSURE IRRIGATION MAIN PIPELINES SHALL BE 6-INCH MINIMUM, UNLESS APPROVED OTHERWISE BY THE CITY ENGINEER.
7. TELECOMMUNICATIONS CONDUIT SHALL BE LAID WHERE TELEPHONE CONDUIT IS LAID.
8. REQUIRED COVER OVER UTILITY LINES SHALL BE AS FOLLOWS:
CULINARY WATER = 48" MINIMUM
PRESSURE IRRIGATION = 24" MINIMUM
SANITARY SEWER = PER DESIGN
STORM DRAIN = PER DESIGN
TELECOMMUNICATIONS = 24" MINIMUM
ALL OTHERS = PER UTILITY REQUIREMENTS
9. SIDEWALK NOT REQUIRED IN INDUSTRIAL ZONES WEST OF GENEVA ROAD.