LINDON
100 NORTH STATE
(801) 785-7687

1.5" & 2" CULINARY WATER SERVICE CONNECTION

DRAWN:	DESIGN:	REVISION:	ADOPTED:
NDG	NDG		01/03/20

16b

NOTES:
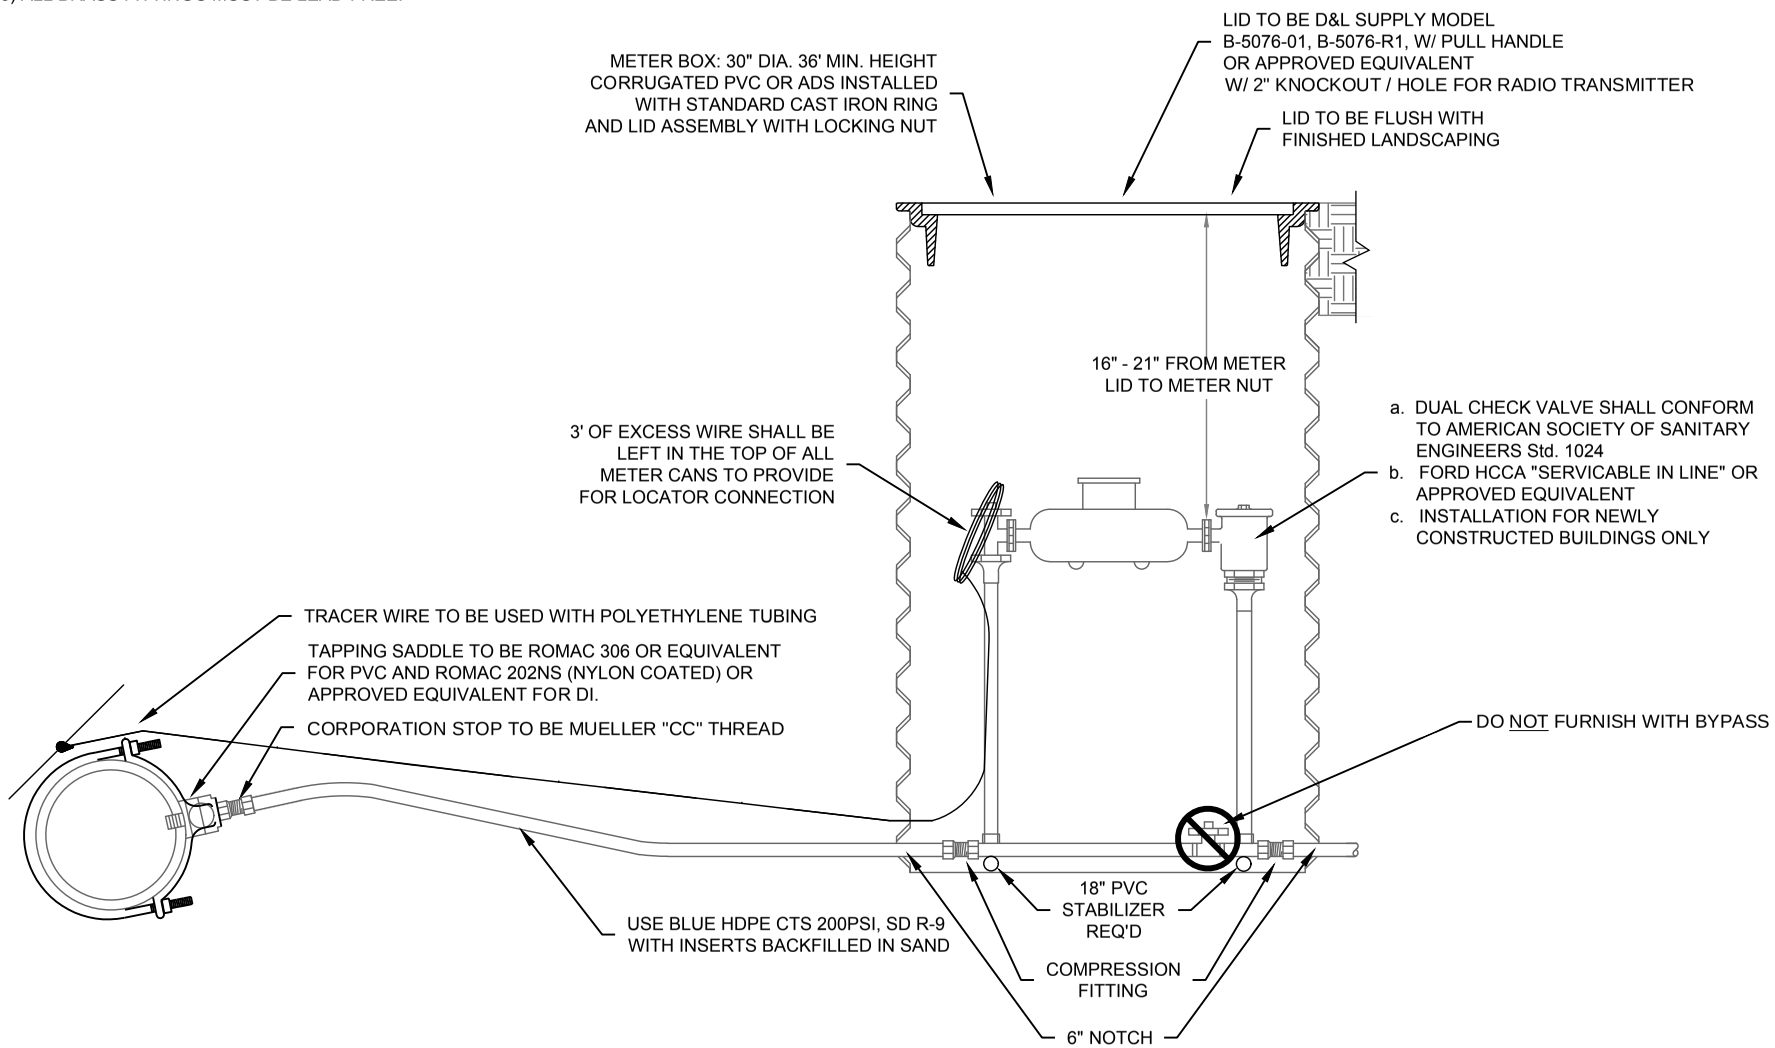
1) MIN. COVER ON SERVICE LINE IS 42".
2) FOR INSTALLATIONS WITH CONTINUOUS TRAFFIC FLOW ON METER LID, A STANDARD MANHOLE SECTION CONE WITH 36" MIN. HEIGHT REINFORCED CONCRETE WITH STANDARD 30" MANHOLE RING AND COVER SHALL BE USED AS APPROVED BY WATER SECTION PERSONNEL.
3) TRACER WIRE SHALL BE 12 GAUGE SOLID INSULATED COPPER WIRE INSTALLED WITHIN 6" ABOVE TOP OF PIPE.
4) WIRE IS TO BE SPLICED IN AT ALL SERVICE CONNECTIONS TO THE MAIN AND COVERED OR COATED WITH CORROSION PROTECTION SUCH AS GEL CAPS OR MASTIC PAD.
5) POLY INSERTS ARE REQUIRED WITH COMPRESSION FITTING.
6) ALL BRASS FITTINGS MUST BE LEAD-FREE.