


BOXES AND FITTINGS
SAME AS OTHER SIDE

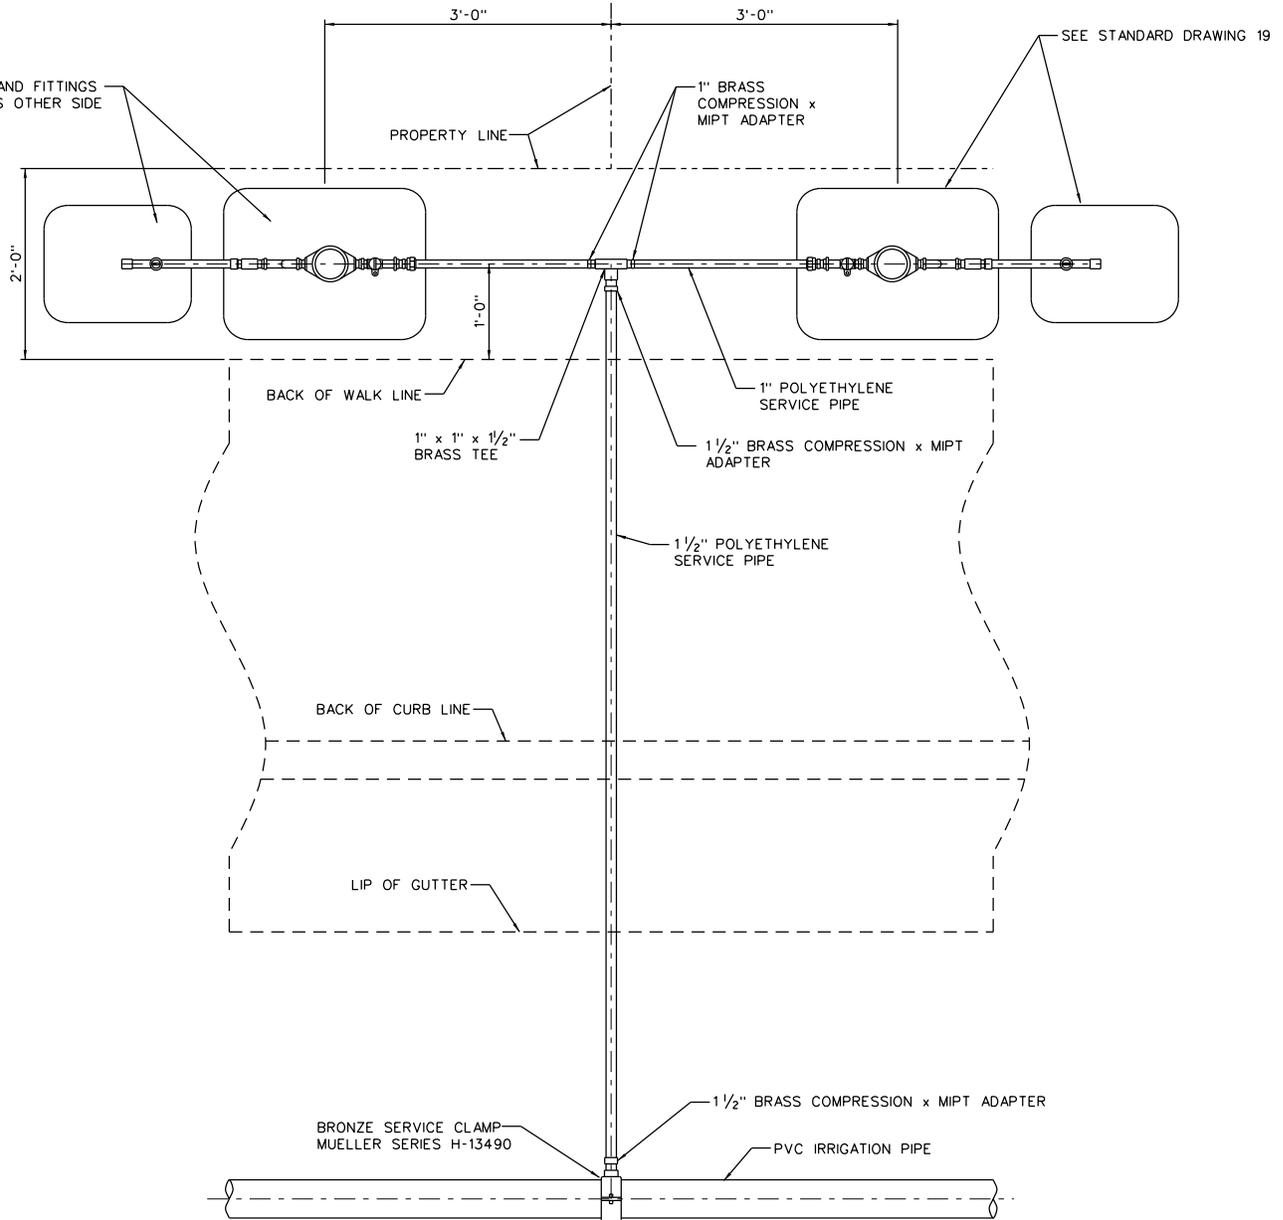

IRRIGATION CONNECTION NOTES:

1-1/2" SERVICE CONNECTION TO MAIN:
USE MUELLER SERIES H-13490 AND A BRASS COMPRESSION X MIPT ADAPTER. A RIGID LINER SHALL BE USED INSIDE OF TUBING AT THE COMPRESSION FITTINGS ON 1", 1-1/2" AND 2" SERVICE LINES.

GENERAL:

ALL FITTINGS SHALL BE COMPATIBLE WITH SERVICE SIZE.

PLACE THE UTILITY BOX IN THE PLANTER STRIP ON STREETS HAVING A PLANTER STRIP.

ON STREETS WITH NO SIDEWALK PLACE THE UTILITY BOX AT A LOCATION THAT WILL MATCH THIS DETAIL AFTER THE SIDEWALK IS CONSTRUCTED.

LINDON CITY RECOMMENDS A FILTER ON THE SPRINKLING SYSTEM.

INSTALL LOCATING WIRE WITH SERVICE CONNECTIONS.



STATEMENT OF USE

THIS DOCUMENT AND ANY ILLUSTRATIONS HEREON ARE PROVIDED AS STANDARD CONSTRUCTION DETAILS WITHIN LINDON CITY. DEVIATION FROM THIS DOCUMENT REQUIRES APPROVAL OF LINDON CITY, LINDON CITY CORPORATION AND J-U-B ENGINEERS CAN NOT BE HELD LIABLE FOR MISUSE OR CHANGES REGARDING THIS DOCUMENT.

REVISION

NO.	DESCRIPTION	BY	APR.	DATE
1	CHANGE TO A METER SETTER SETUP AND LARGER METER BOX. REVISED PART NUMBERS	EEA	MLC	6/26/17
2	CHANGE VALVE TYPE AND PART NUMBER	DWP	MLC	1/21/203
3	MODIFIED VALVE PART NUMBER	MLC	MLC	1/11/203
4	MODIFIED BOX PART NUMBER	MLC	MLC	1/29/208



DOUBLE SERVICE CONNECTION
FOR PRESSURE IRRIGATION

LINDON CITY
100 NORTH STATE

STANDARD DRAWING NUMBER:	18a
CAD DWG-1C_Std0wgs.dwg	
PLOT SCALE:	1:000
DRAWN BY:	EEA
DESIGN BY:	JMC
CHECKED BY:	MLC
ADOPTED DATE:	PENDING